


APT GENERATOR CONTROL

GENERATOR SET

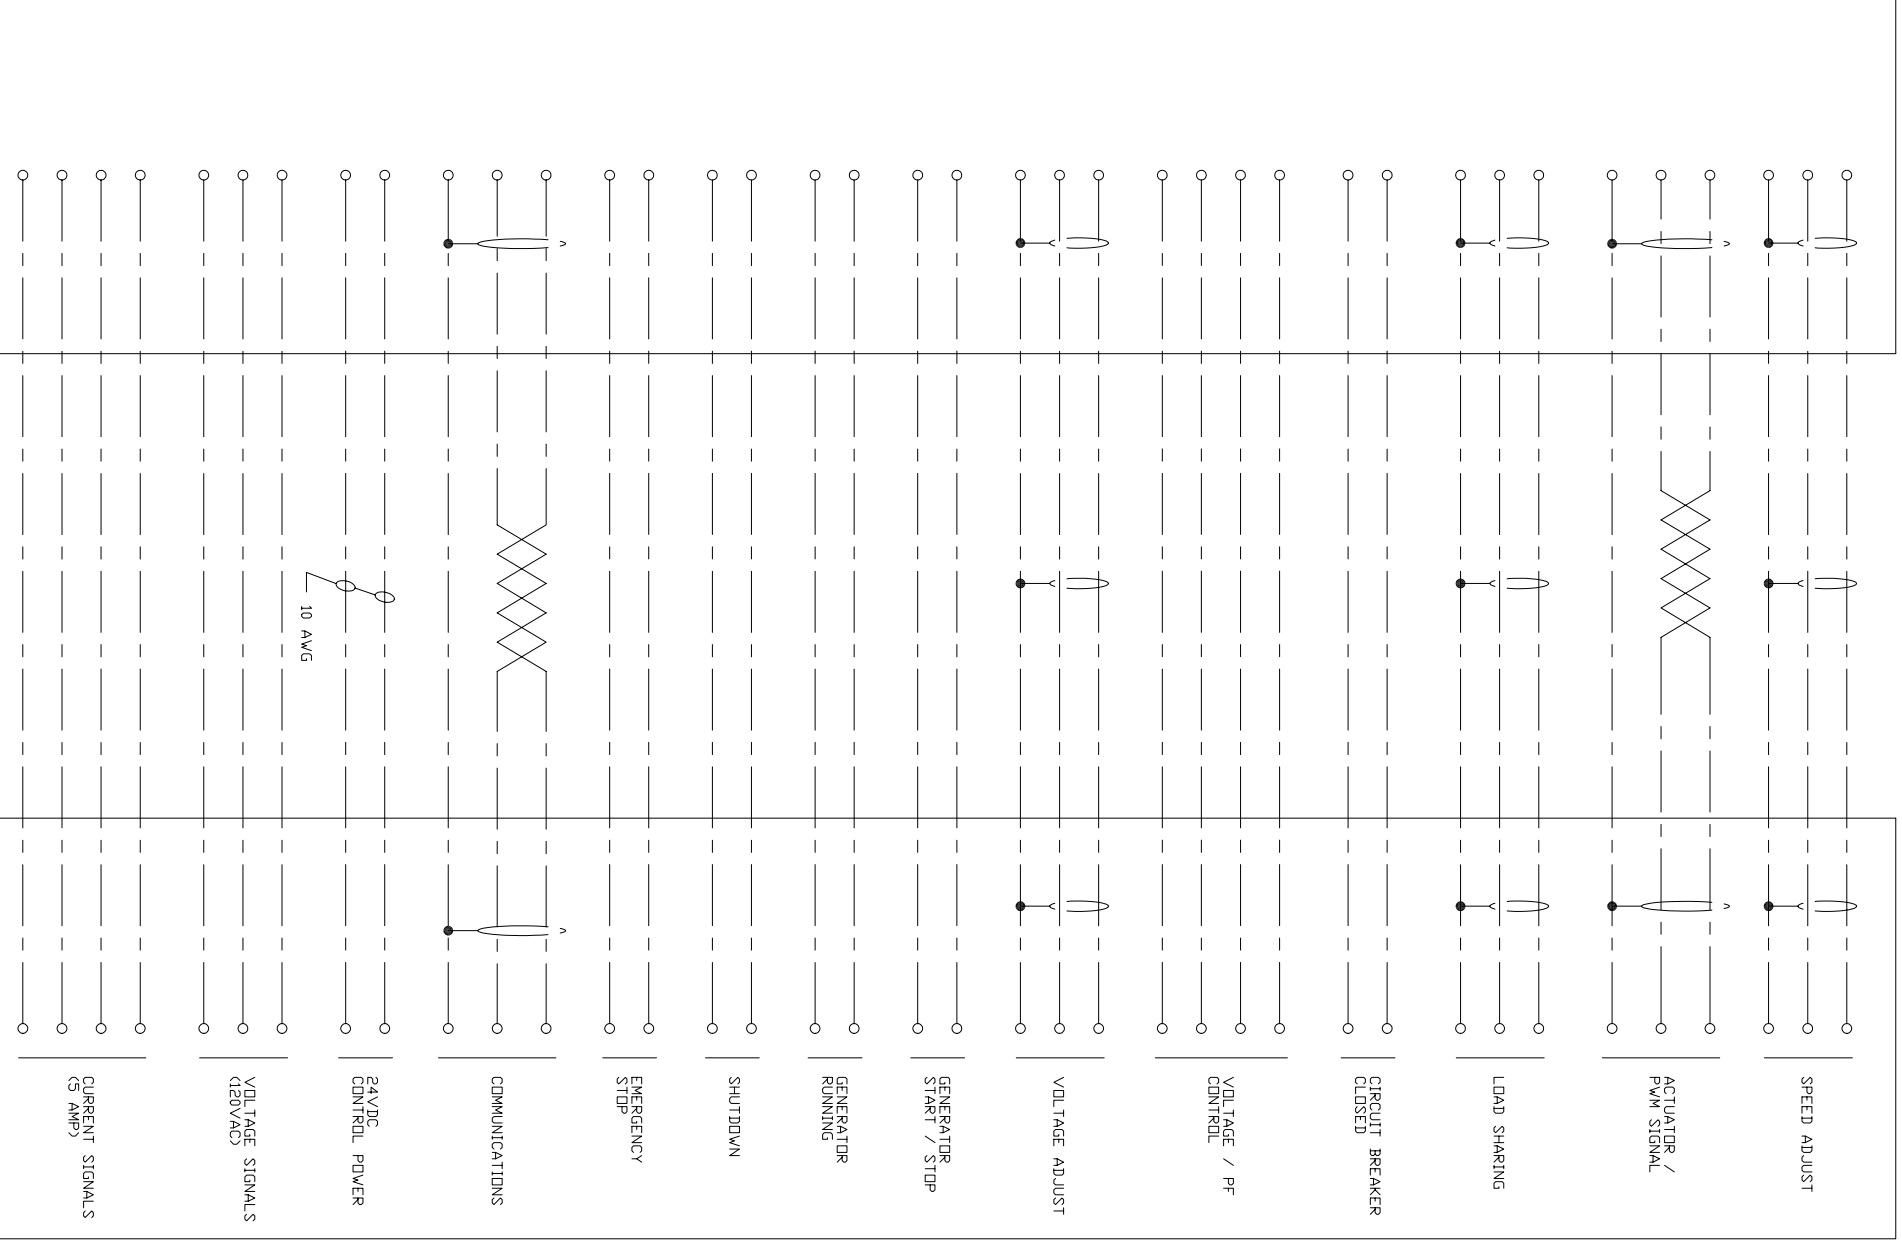


- NOTES:
1. UNLESS OTHERWISE NOTED, UNSHIELDED INTERCONNECT WIRE SHALL BE 14AWG AND SHIELDED INTERCONNECT WIRE SHALL BE 18AWG.
 2. MAIN LOAD CABLE CONNECTIONS NOT SHOWN.
 3. 30% SPARES REQUIRED (QUANTITIES SHOWN DO NOT INCLUDE SPARES)

KEY:
 ——— INTERCONNECT WIRING



PROJECT: TYPICAL FIELD INTERCONNECT	PAGE DESC: APT GENERATOR CONTROL TO GENERATOR SET
PROJ #:	STATUS: INFORMATION

REV: 01	DATE: 4/06/07		
PAGE #: 1 of 2			

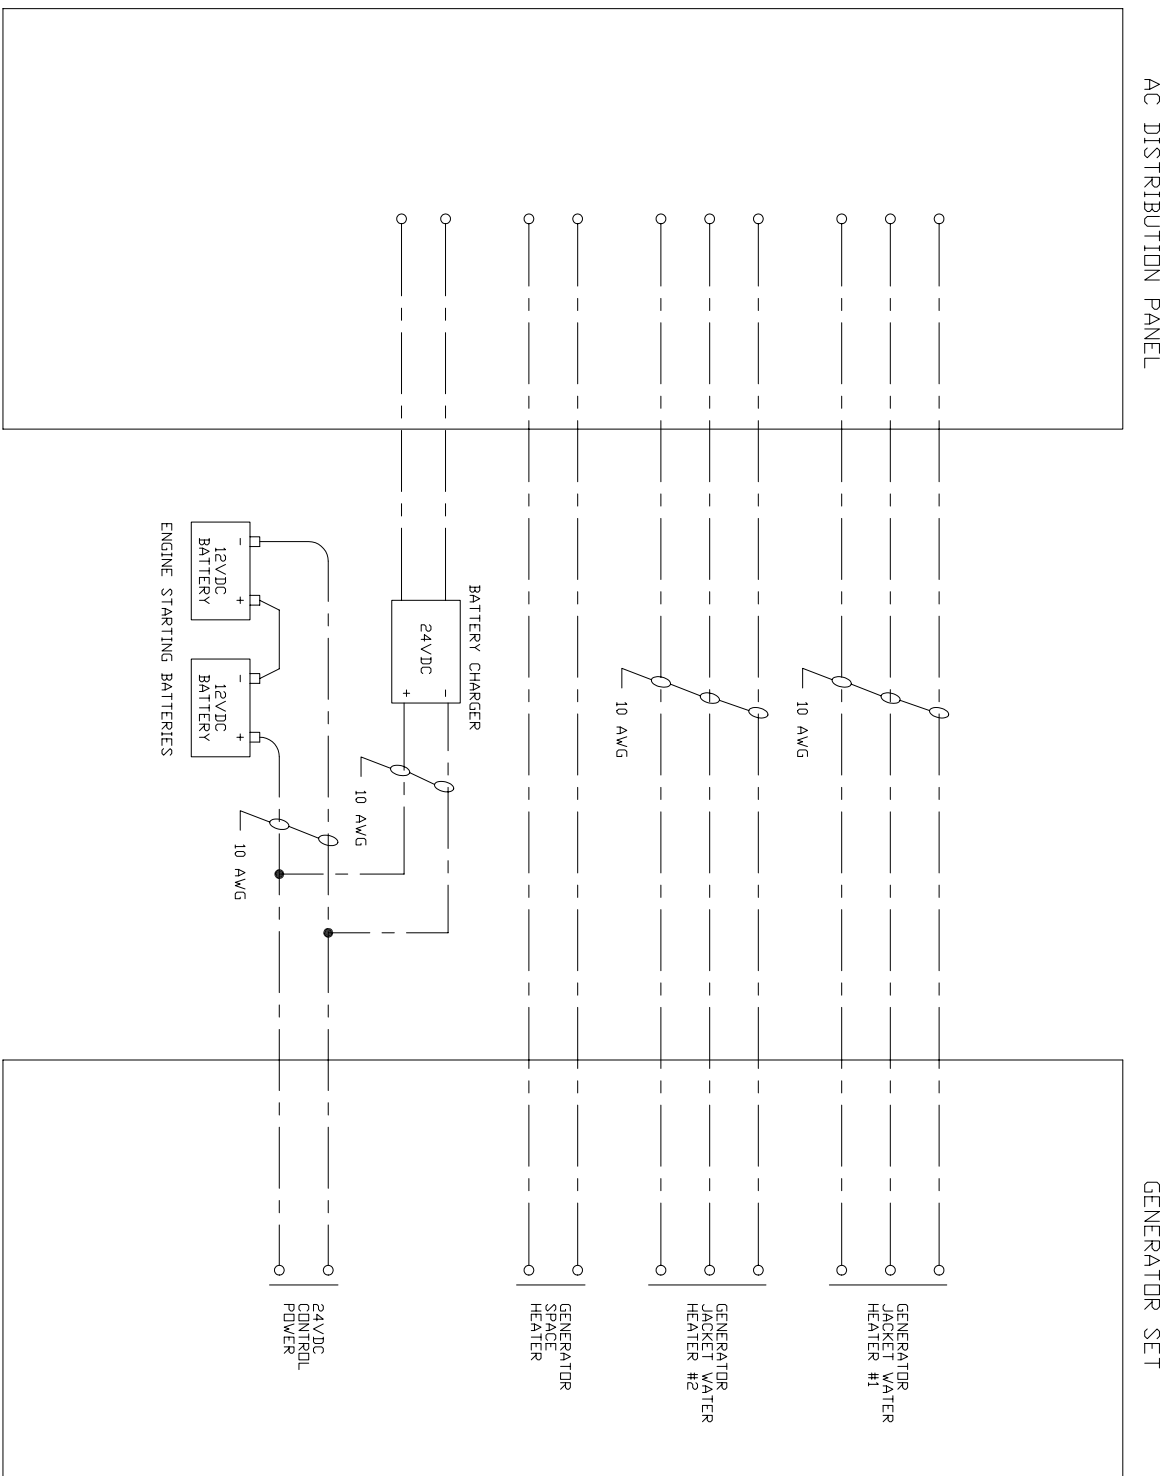

- NOTES:
1. UNLESS OTHERWISE NOTED, UNSHIELDED INTERCONNECT WIRE SHALL BE 14AWG AND SHIELDED INTERCONNECT WIRE SHALL BE 18AWG.
 2. MAIN LOAD CABLE CONNECTIONS NOT SHOWN.
 3. 30% SPARES REQUIRED (QUANTITIES SHOWN DO NOT INCLUDE SPARES)

KEY:

— — — — INTERCONNECT WIRING